

REVISIONS

95% SUBMISSION

DATE

CSHQA

C.W. MOORE PLAZA
250 S. 5TH ST.
BOISE, IDAHO 83721
(208) 343-4355 • FAX (208) 343-1555
http://www.cshqa.com

BOISE, IDAHO
250 S. 5TH ST.
BOISE, IDAHO 83721
PHONE 208-343-4355 FAX 208-343-1555

THIS DRAWING AND THE INFORMATION CONTAINED HEREIN ARE THE PROPERTY OF CSHQA. NO PART OF THIS DRAWING OR THE INFORMATION CONTAINED HEREIN MAY BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN CONSENT OF CSHQA. CSHQA IS NOT LIABLE FOR ANY DAMAGE OR LOSS OF PROFITS, BUSINESS, OR REVENUE, OR FOR ANY SPECIAL, INCIDENTAL, OR CONSEQUENTIAL DAMAGES, INCLUDING ATTORNEY'S FEES, ARISING OUT OF OR FROM THE USE OF THIS DRAWING OR THE INFORMATION CONTAINED HEREIN.

STAMP

PRELIMINARY
NOT FOR
CONSTRUCTION

PROJECT TITLE
VAMC
RENOVATE
BUILDING 33

BUILDING NUMBER
33

LOCATION
BOISE, IDAHO

DATE
03/04/11



PROJECT NO.
531-10-114

CHECKED
RME


DRAWN
DJH

DWG NO.
M3.1


DWG 03 OF 102

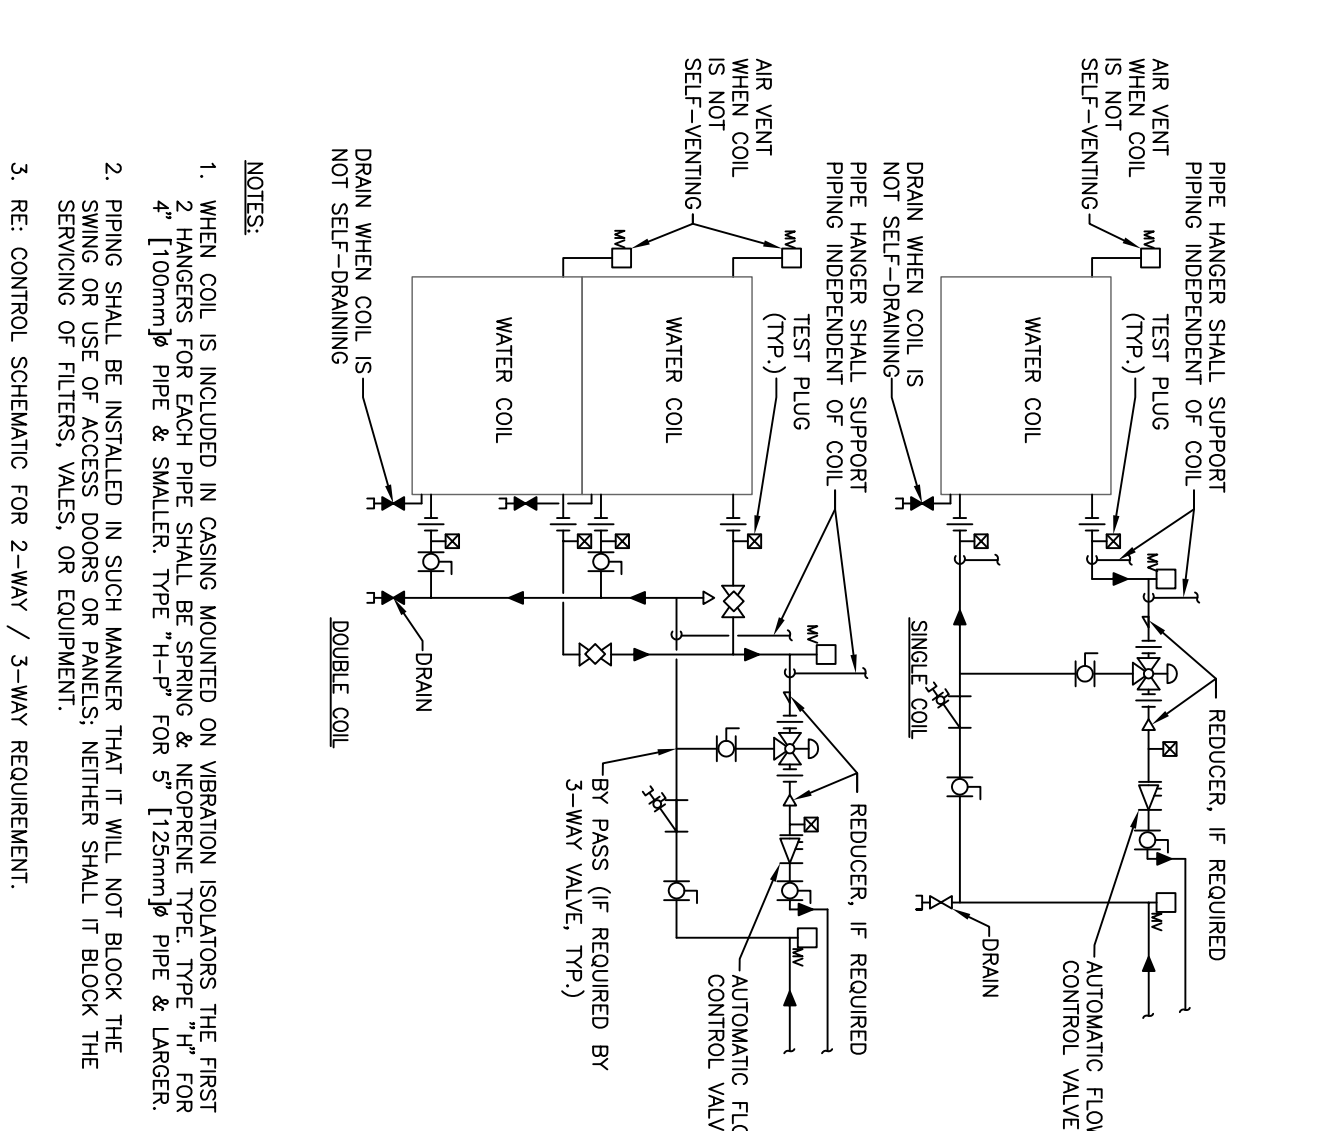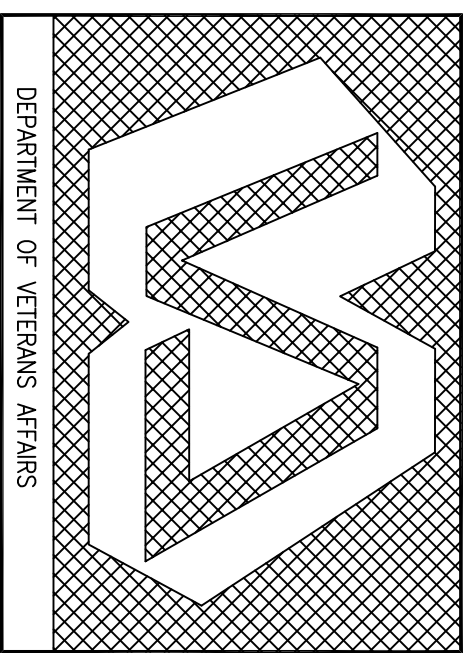


1 WATER COILS - PIPING CONNECTIONS

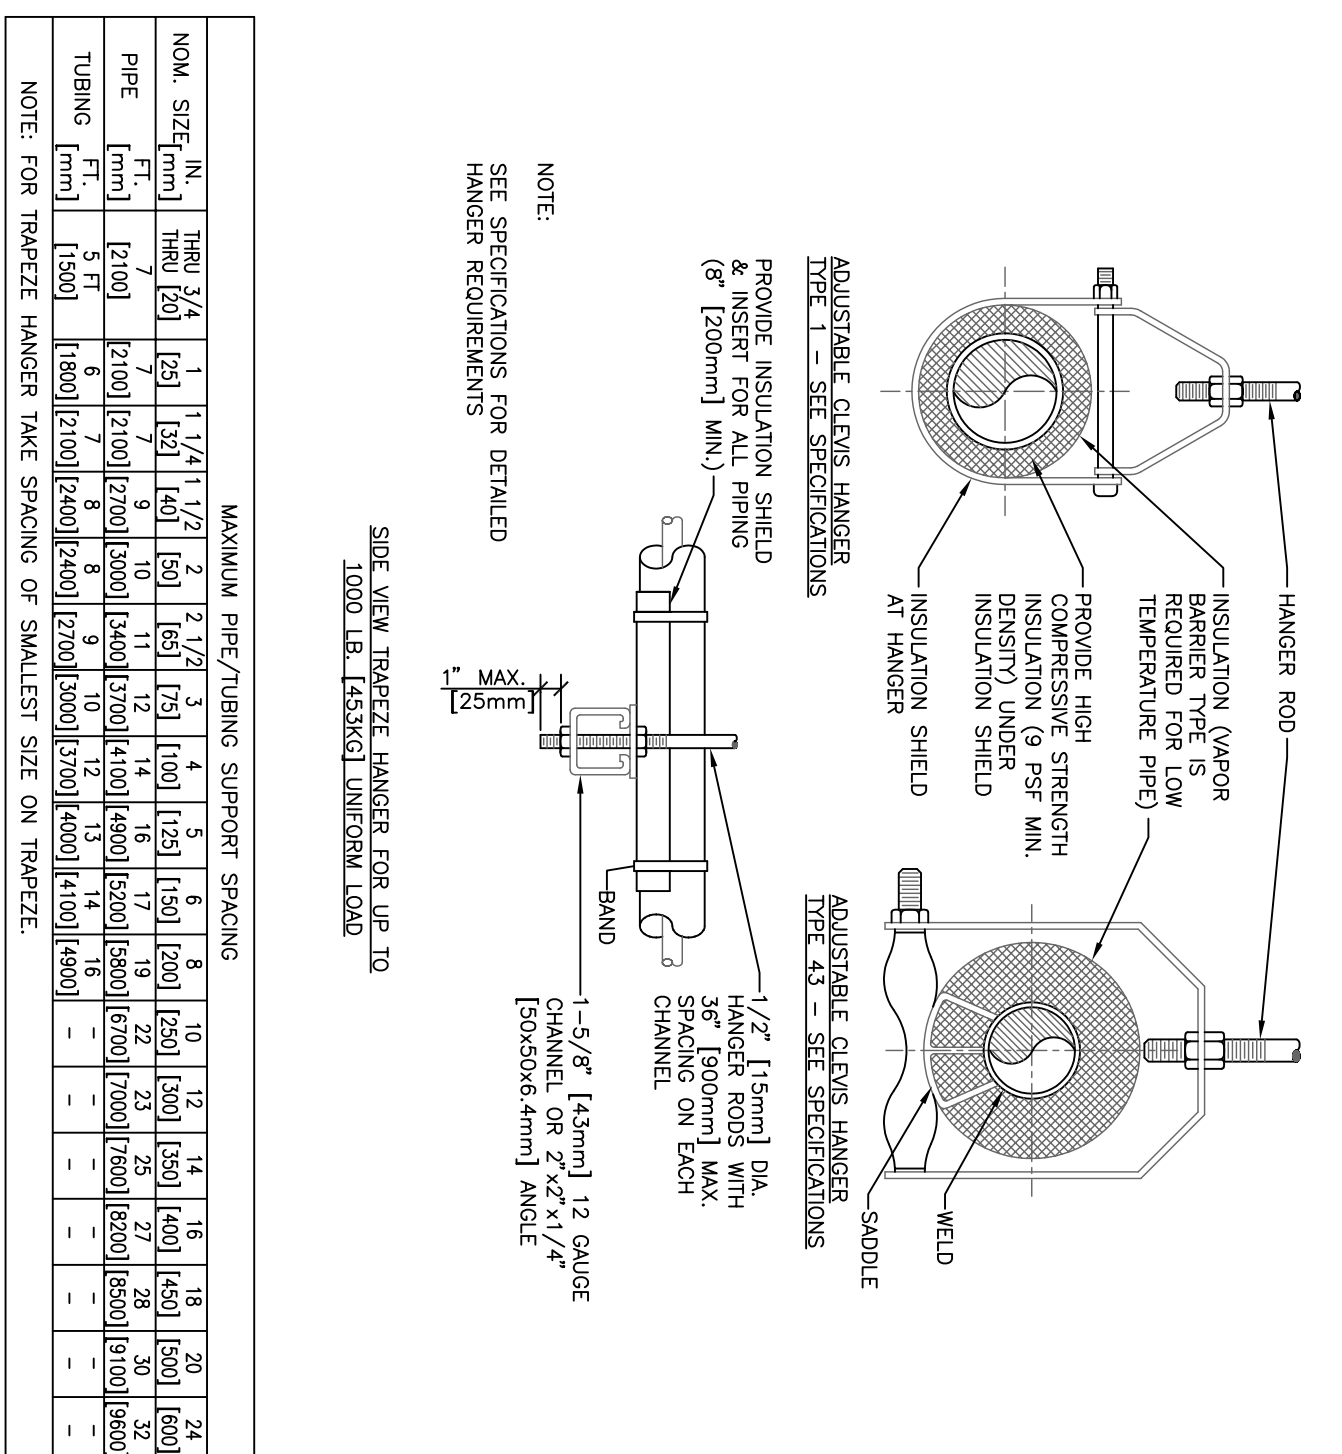


2 PIPE HANGERS

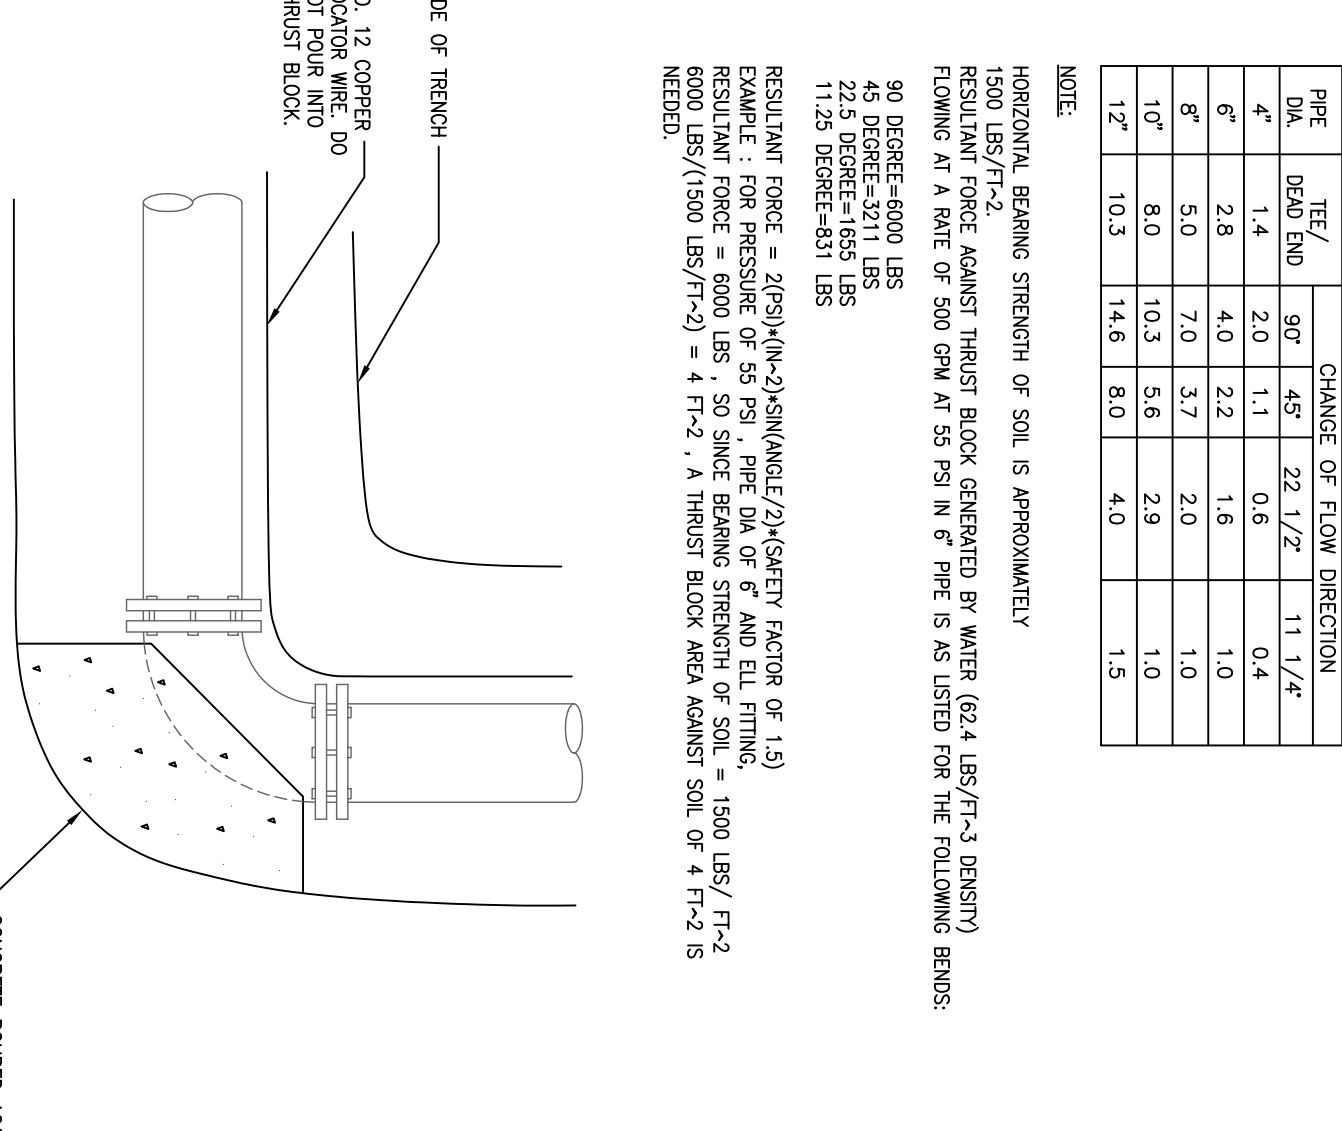


3 THRUST BLOCK DETAIL

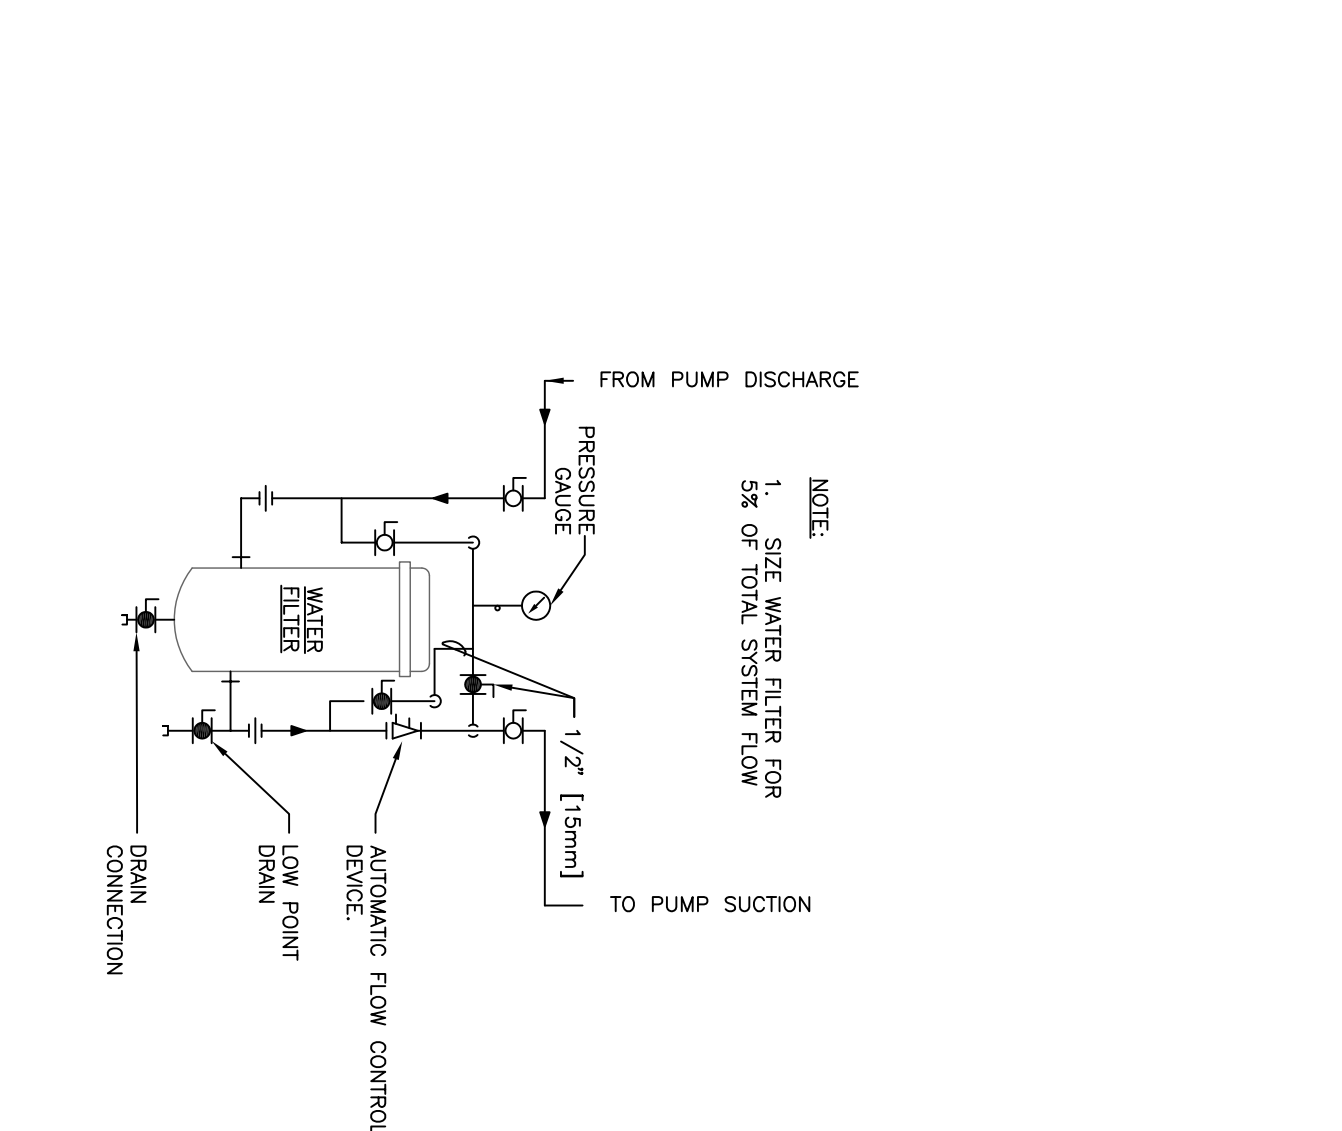


4 CLOSED LOOP HYDRONIC SYSTEMS

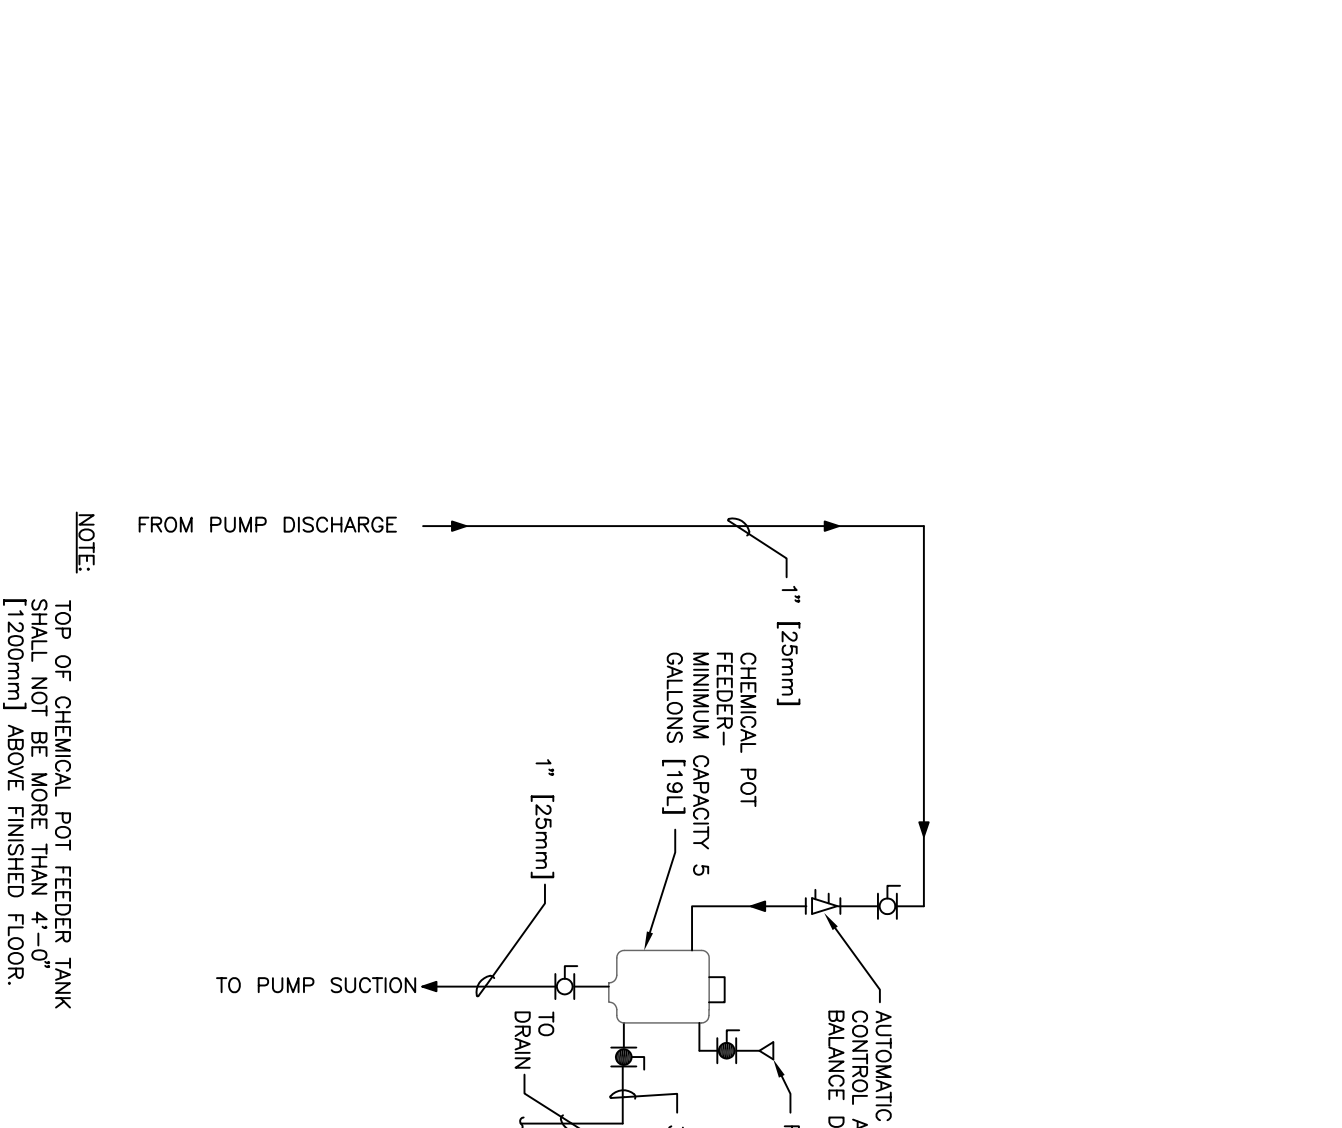


5 WATER TREATMENT - CLOSED SYSTEMS

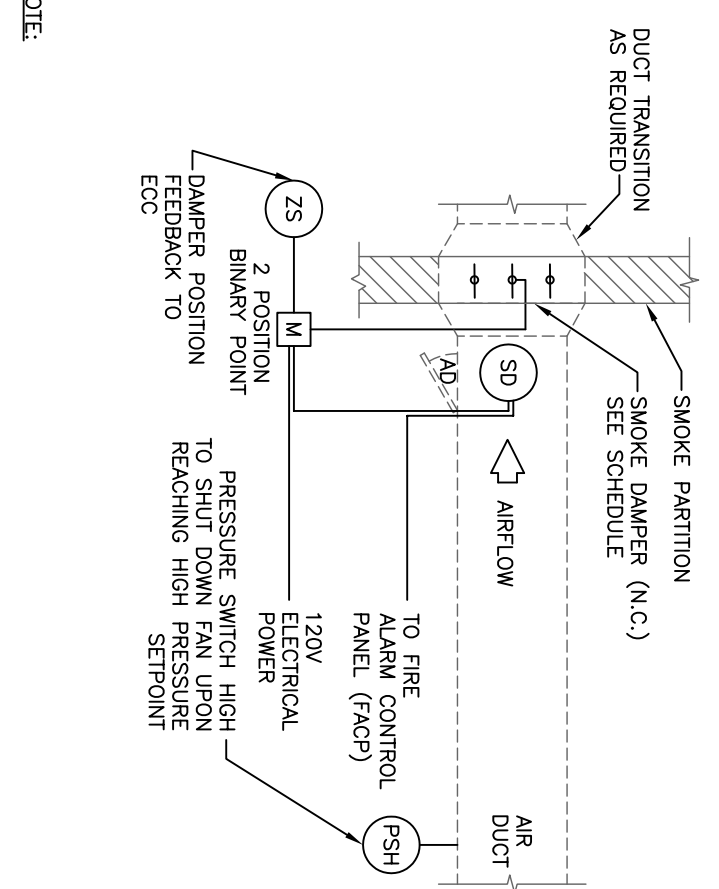


6 SMOKE DAMPER CONTROL DIAGRAM

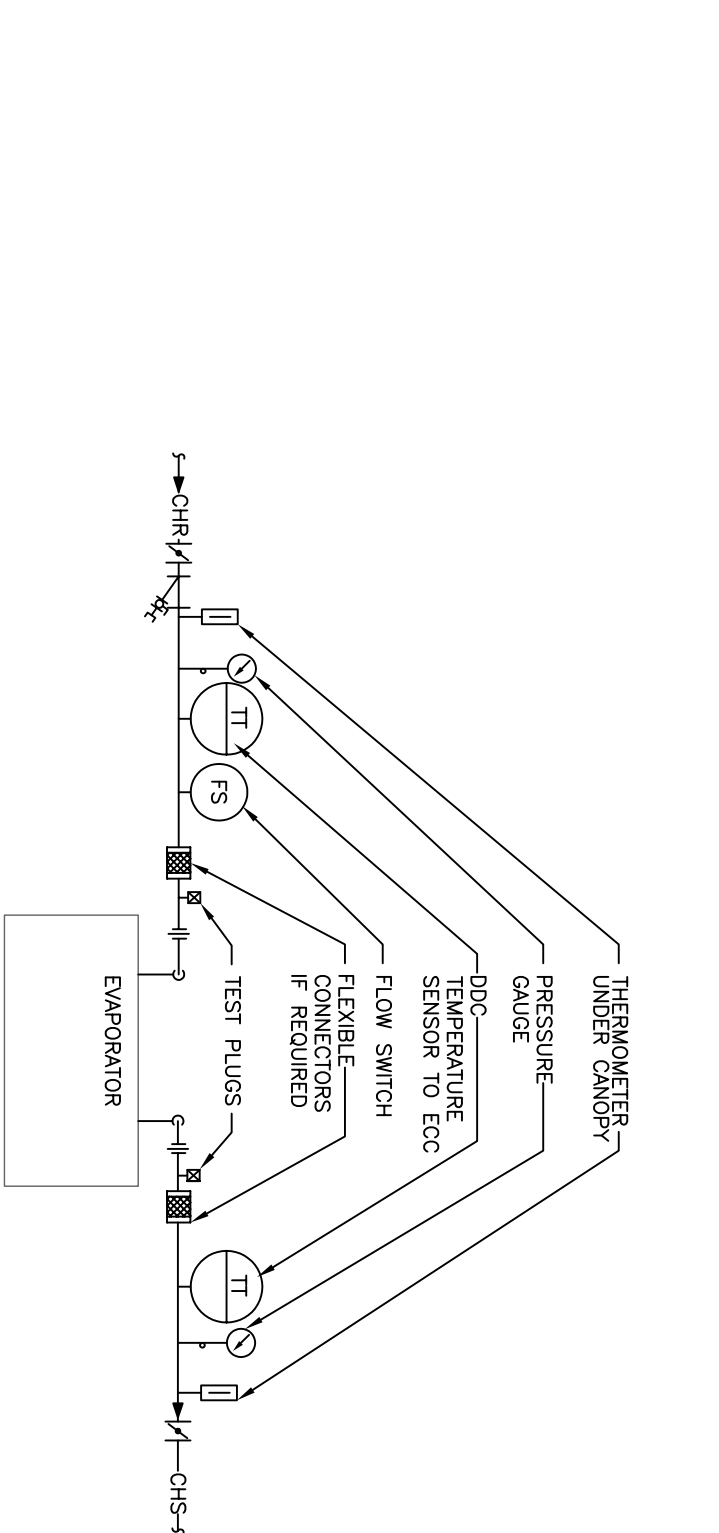


7 AIR COOLED CHILLER - PIPING CONNECTIONS

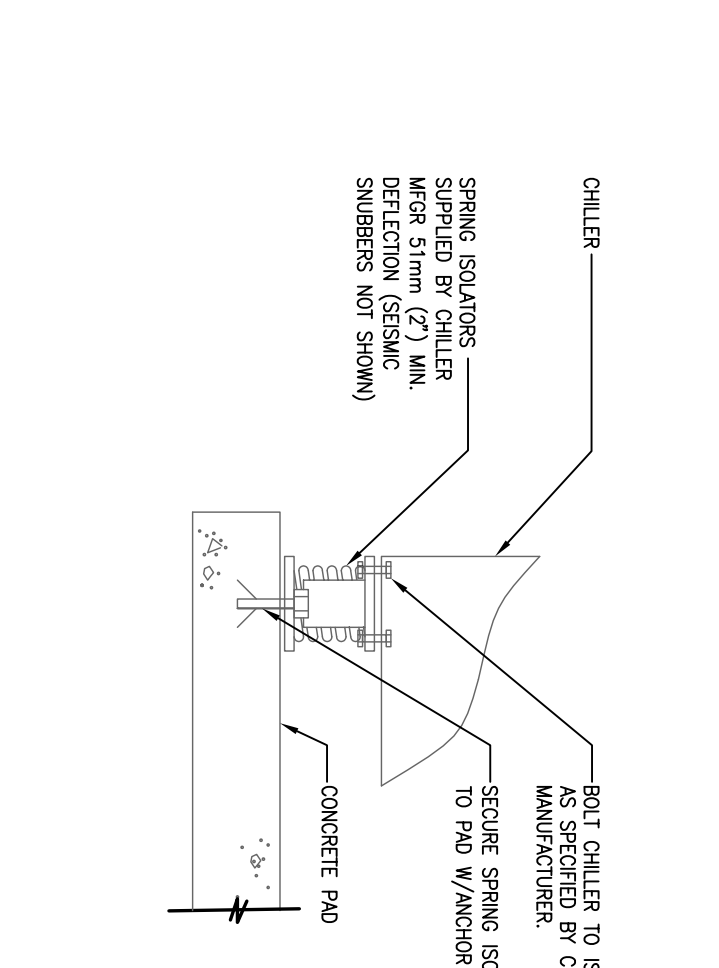

8 CHILLER MOUNTING DETAIL

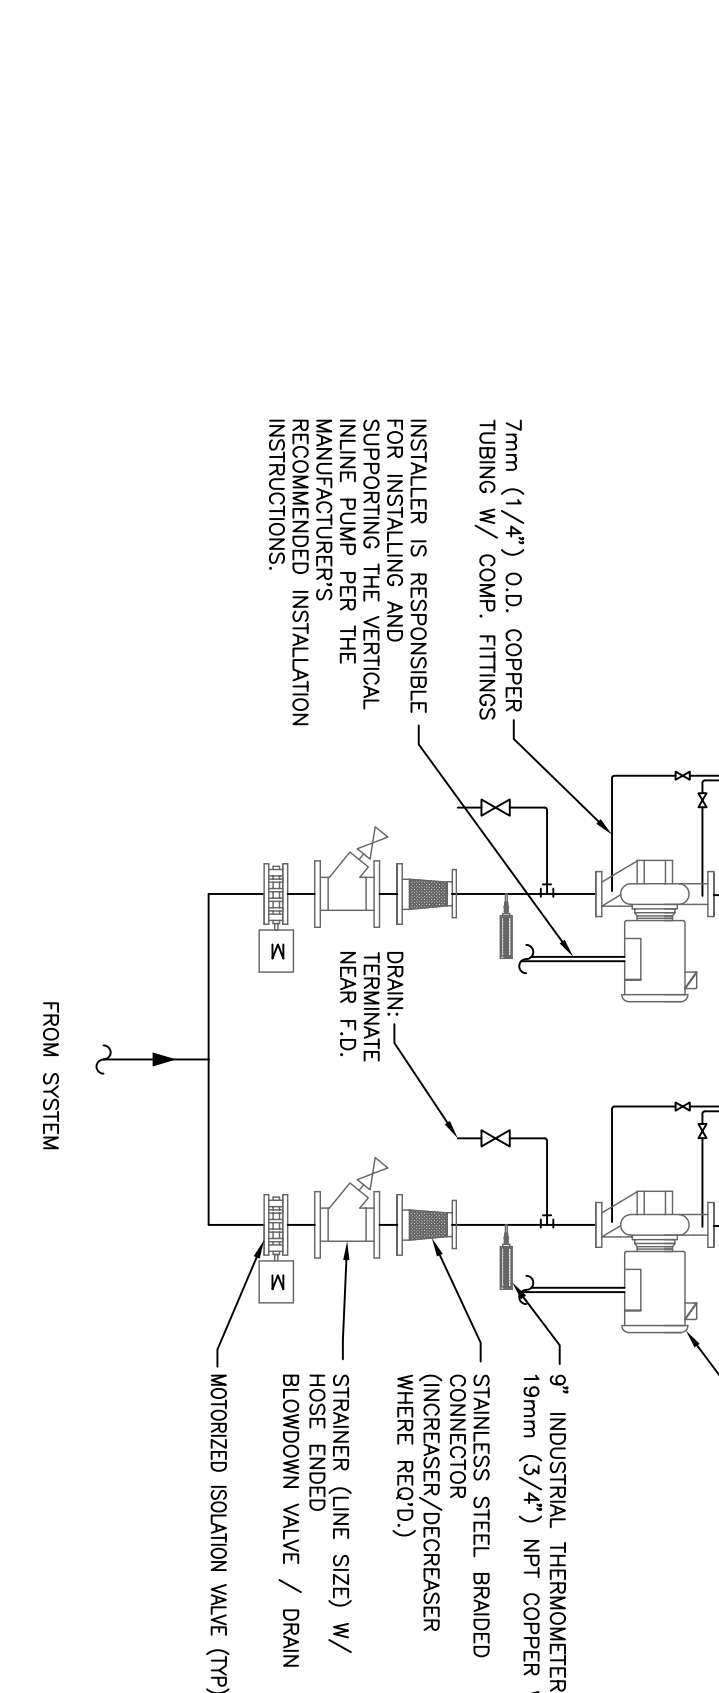


9 VERTICAL INLINE PUMP DETAIL

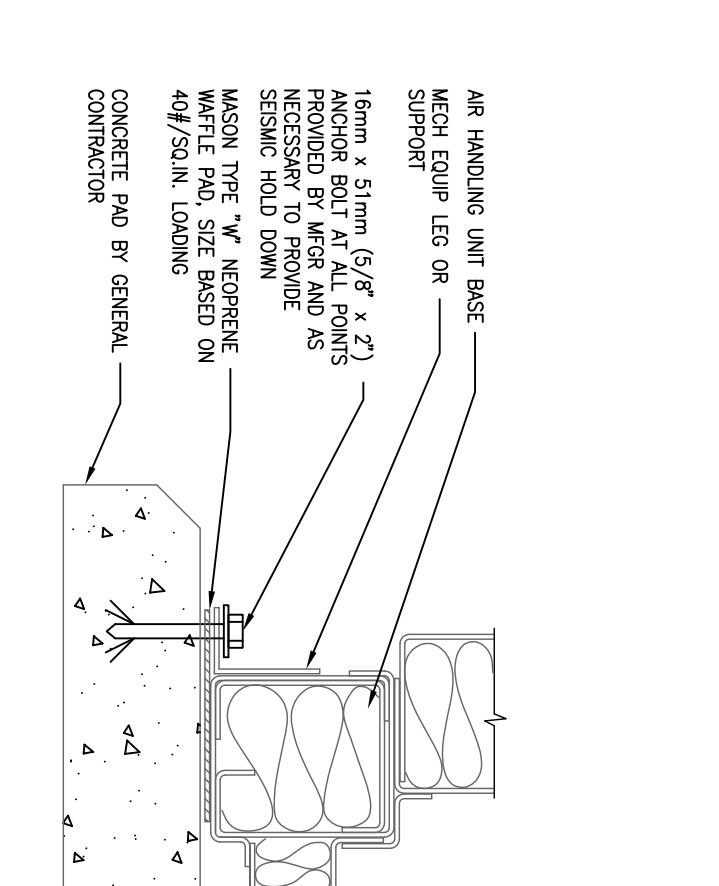


10 AIR HANDLING UNIT MOUNTING DETAIL


11 ACCESS PANEL AND DOOR DETAIL

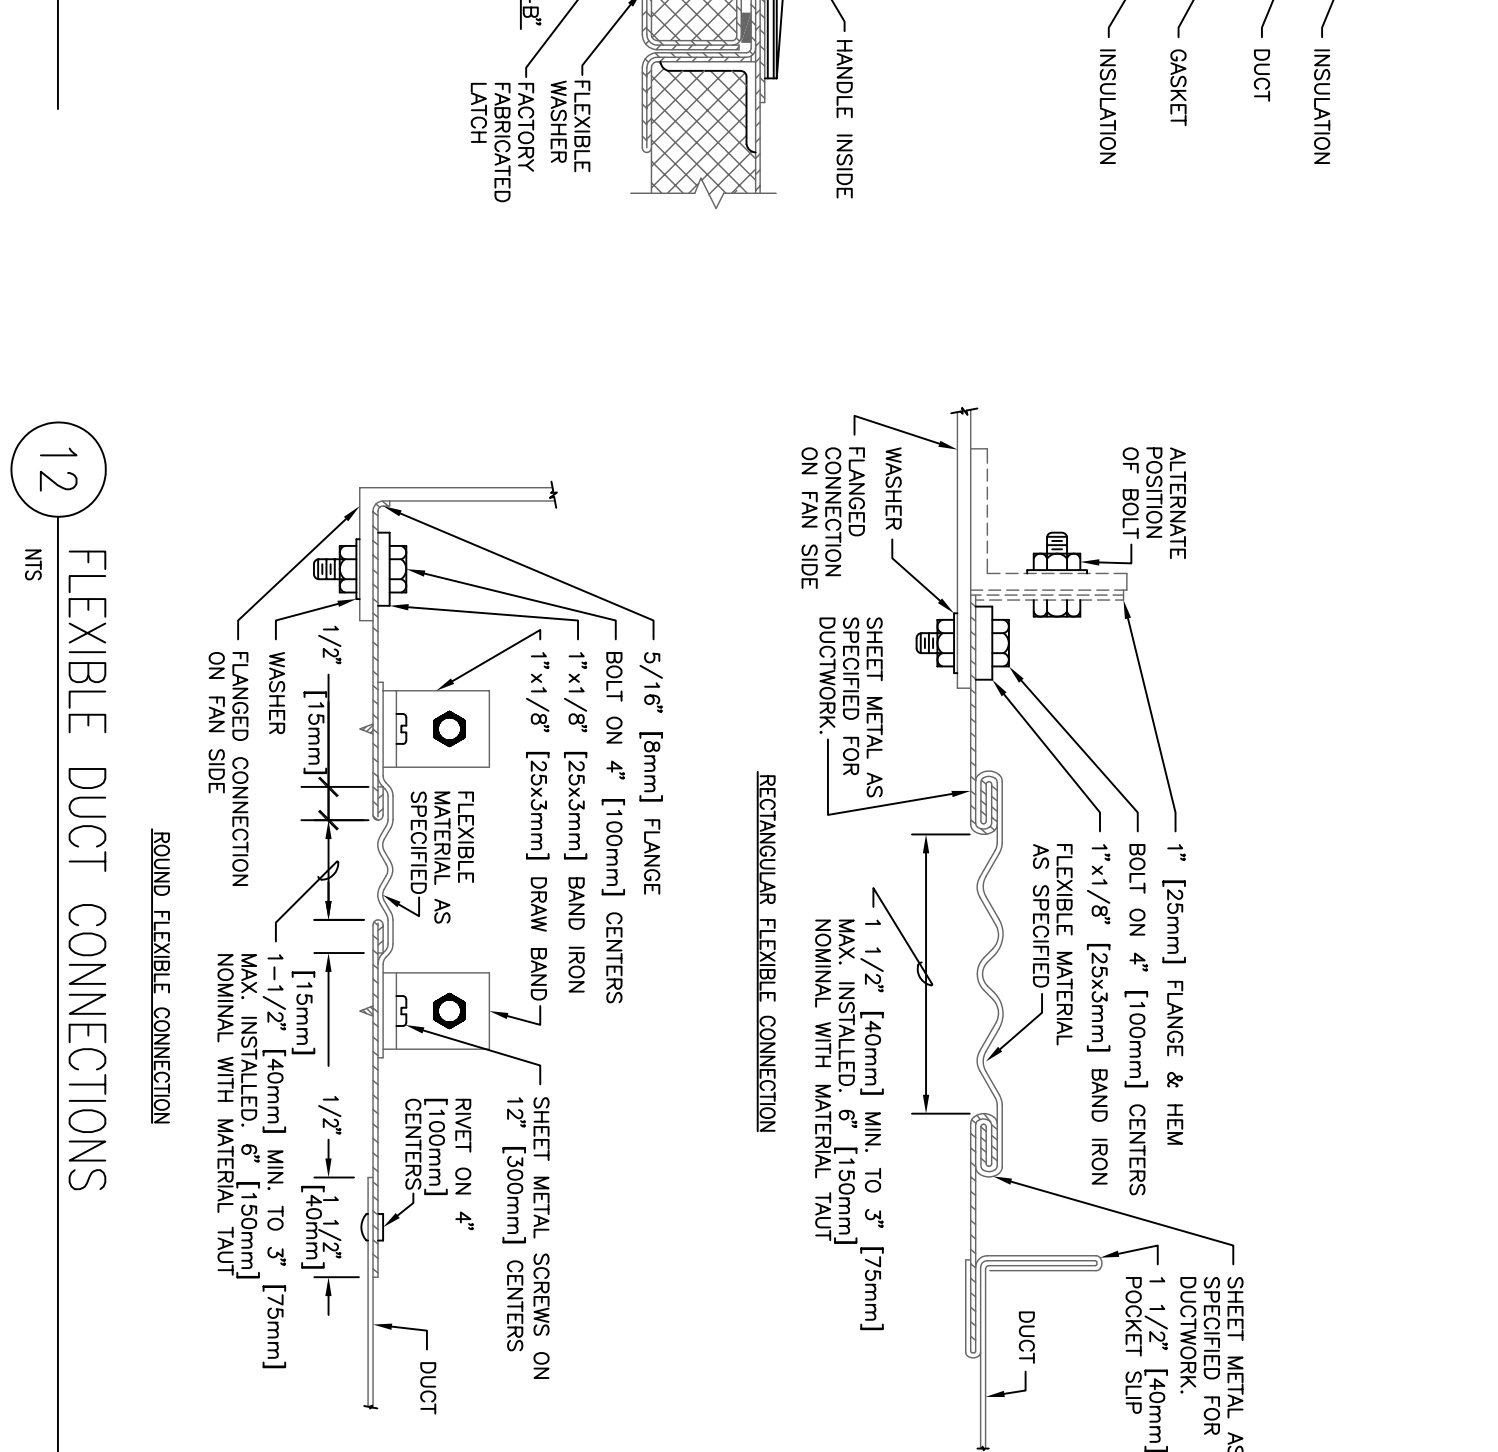

12 FLEXIBLE DUCT CONNECTIONS

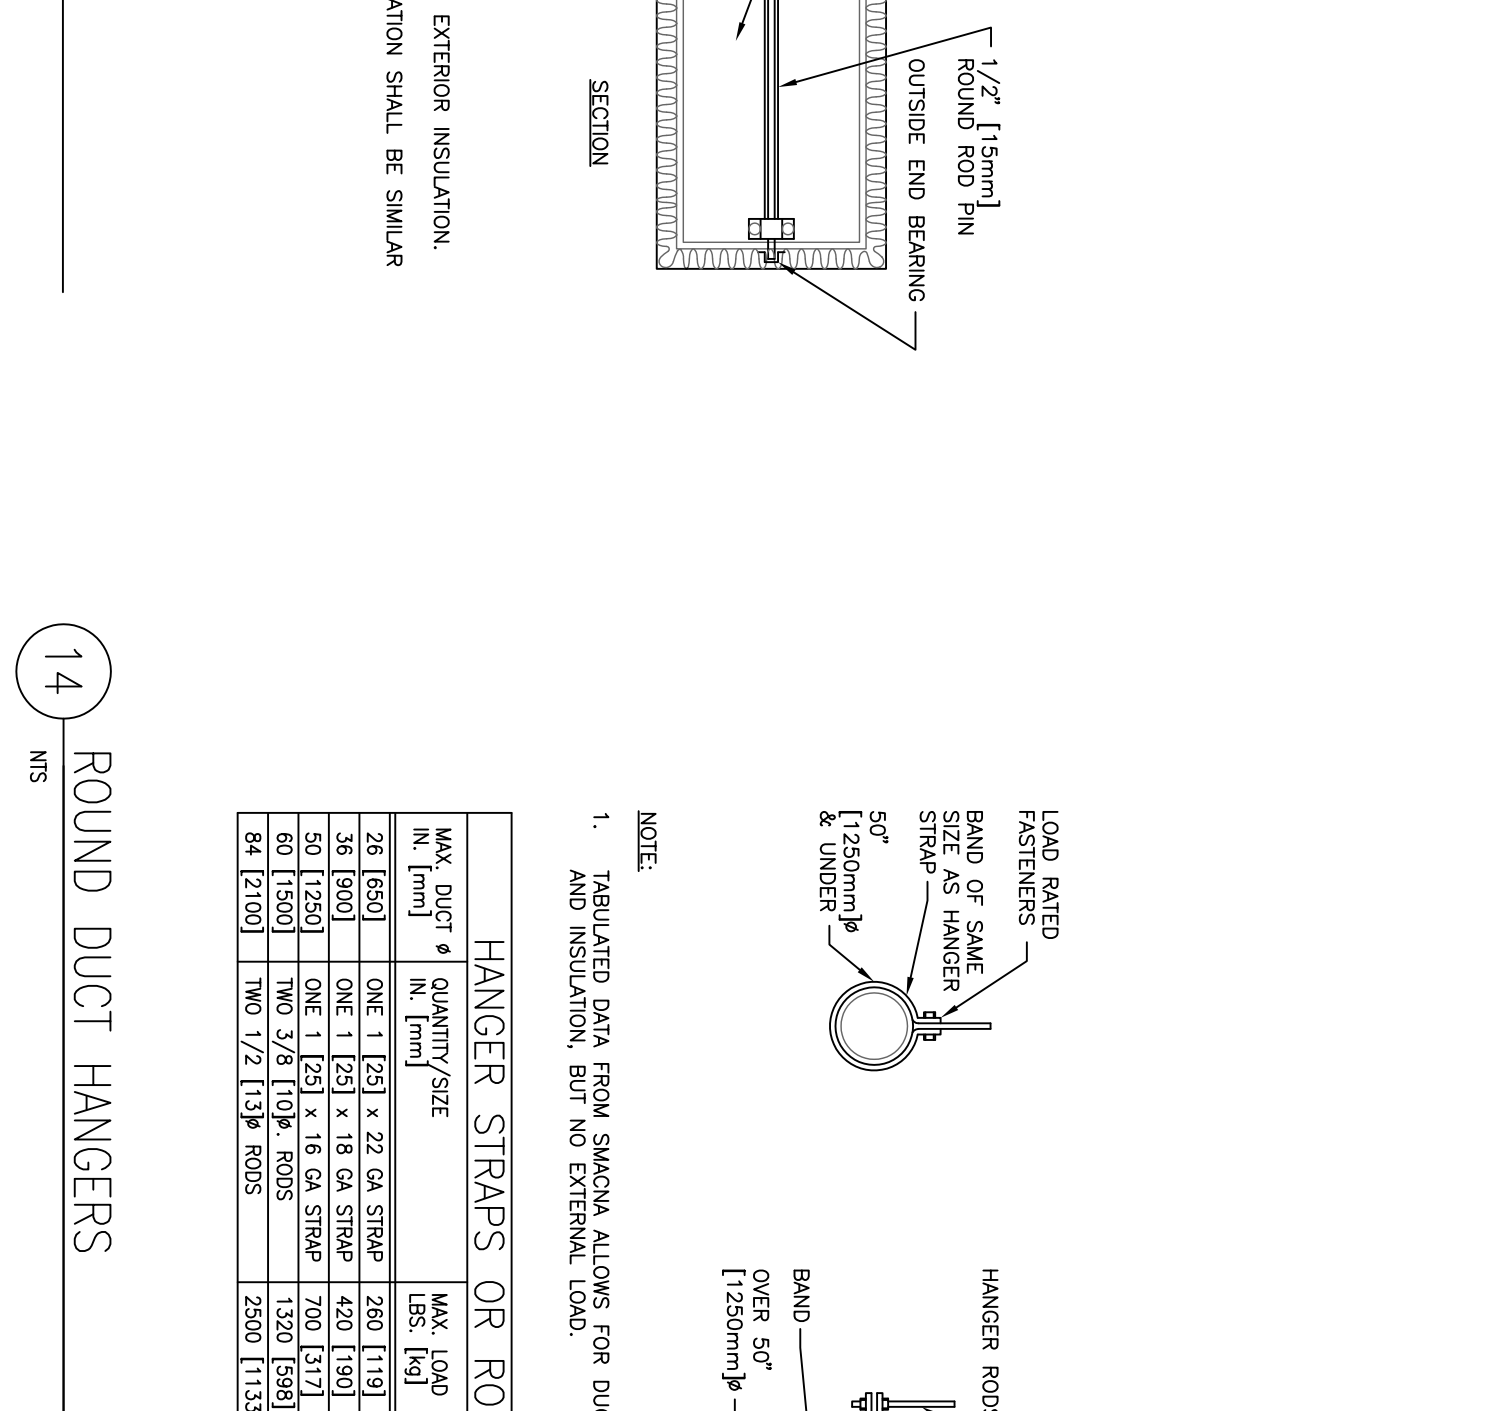

13 VOLUME DAMPER DETAIL

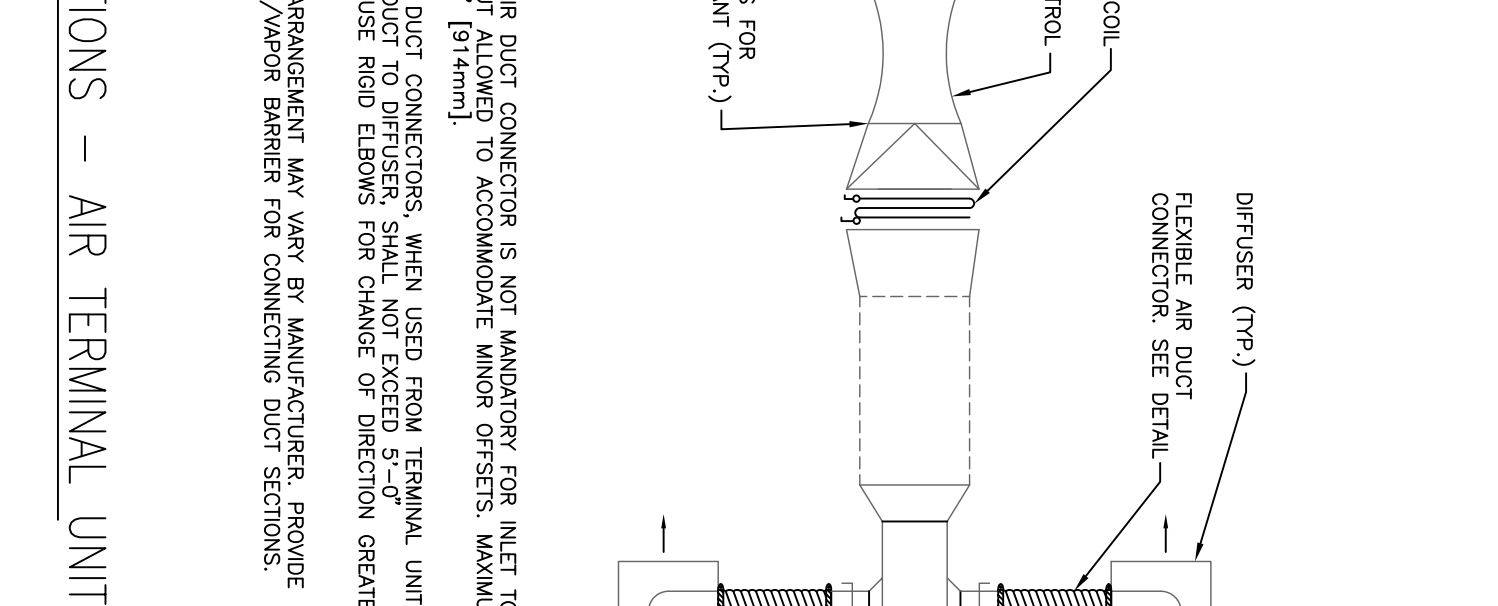

14 ROUND DUCT HANGERS



15 DUCT CONNECTIONS - AIR TERMINAL UNITS

